


## IS YOUR BUILDING IN THE EMERGENCY COMMUNICATIONS DEAD ZONE?


First Responders depend on reliable two-way communications when lives and property are at risk.





### SIGNAL STRENGTH IS IMPAIRED BY:

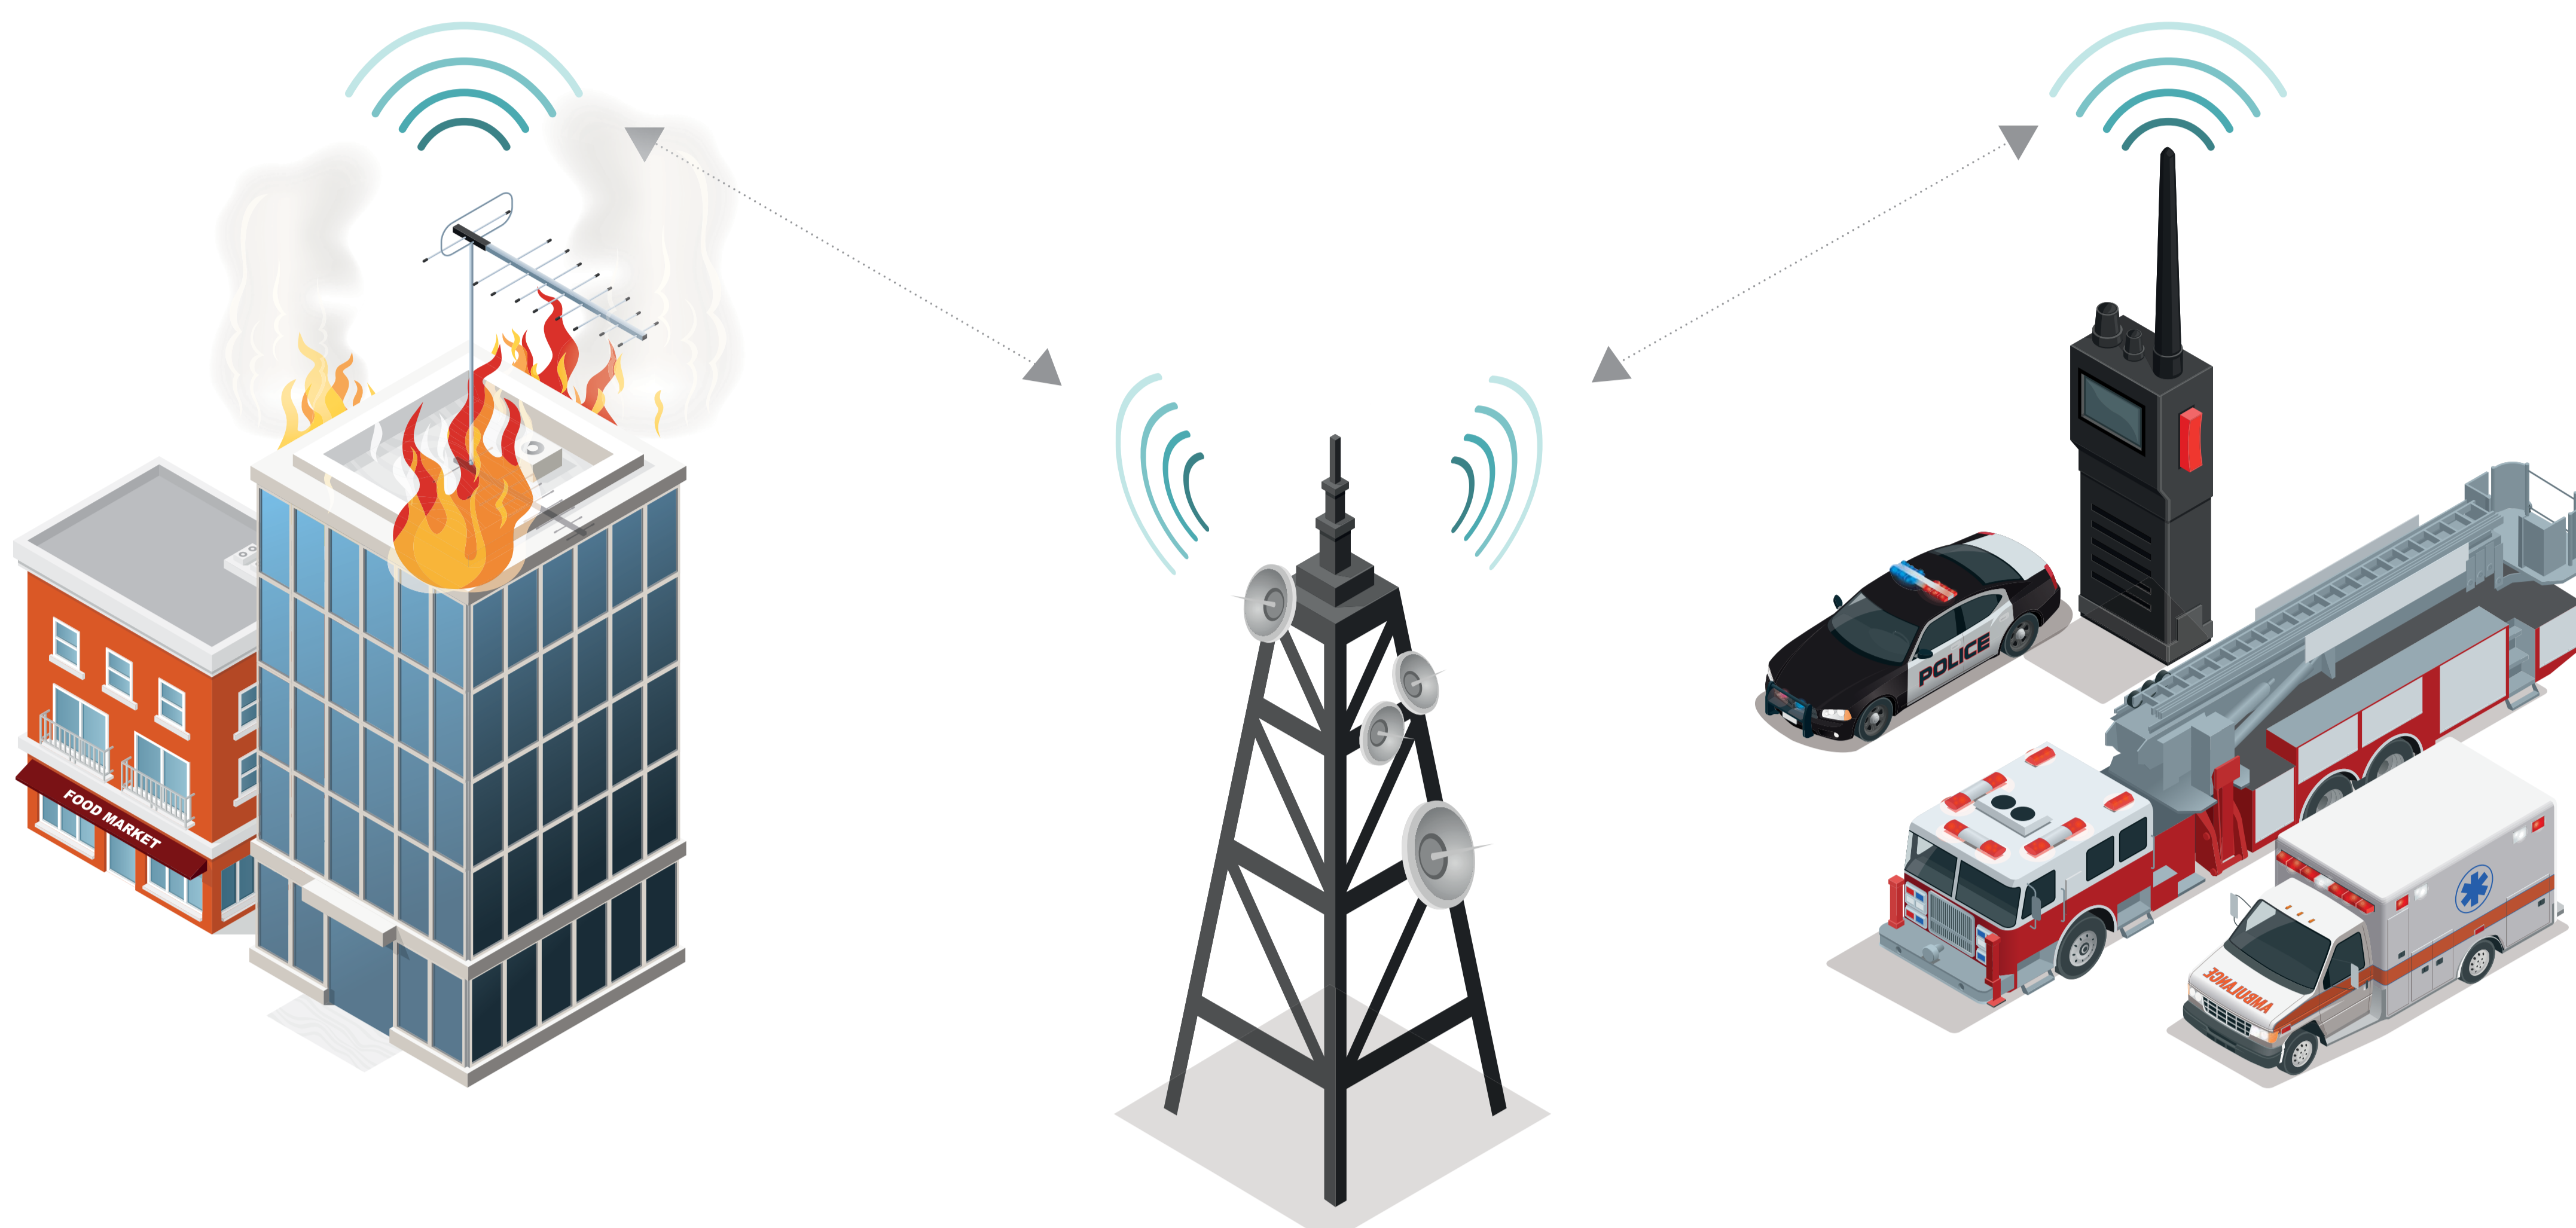

### FIRST RESPONDER COMMUNICATION ISSUES

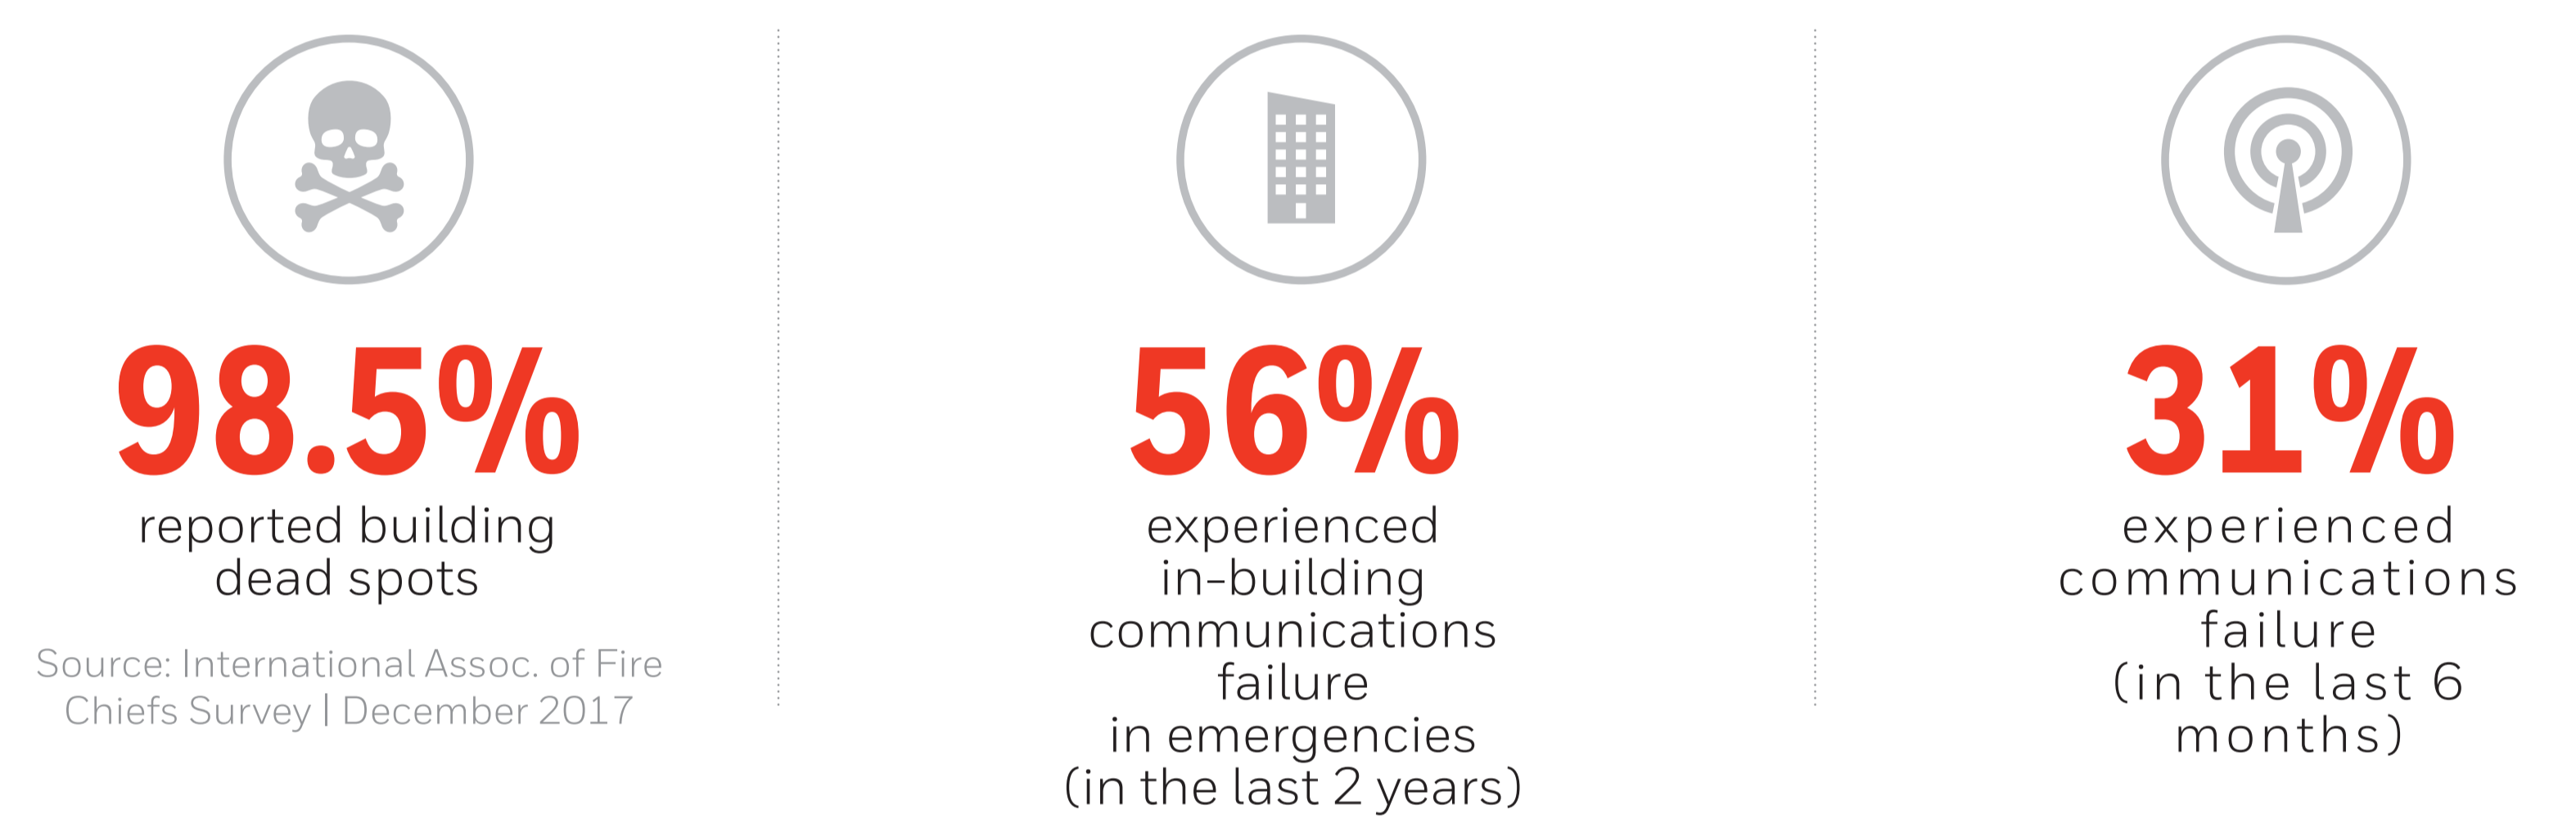

## 100% RELIABLE COMMUNICATION

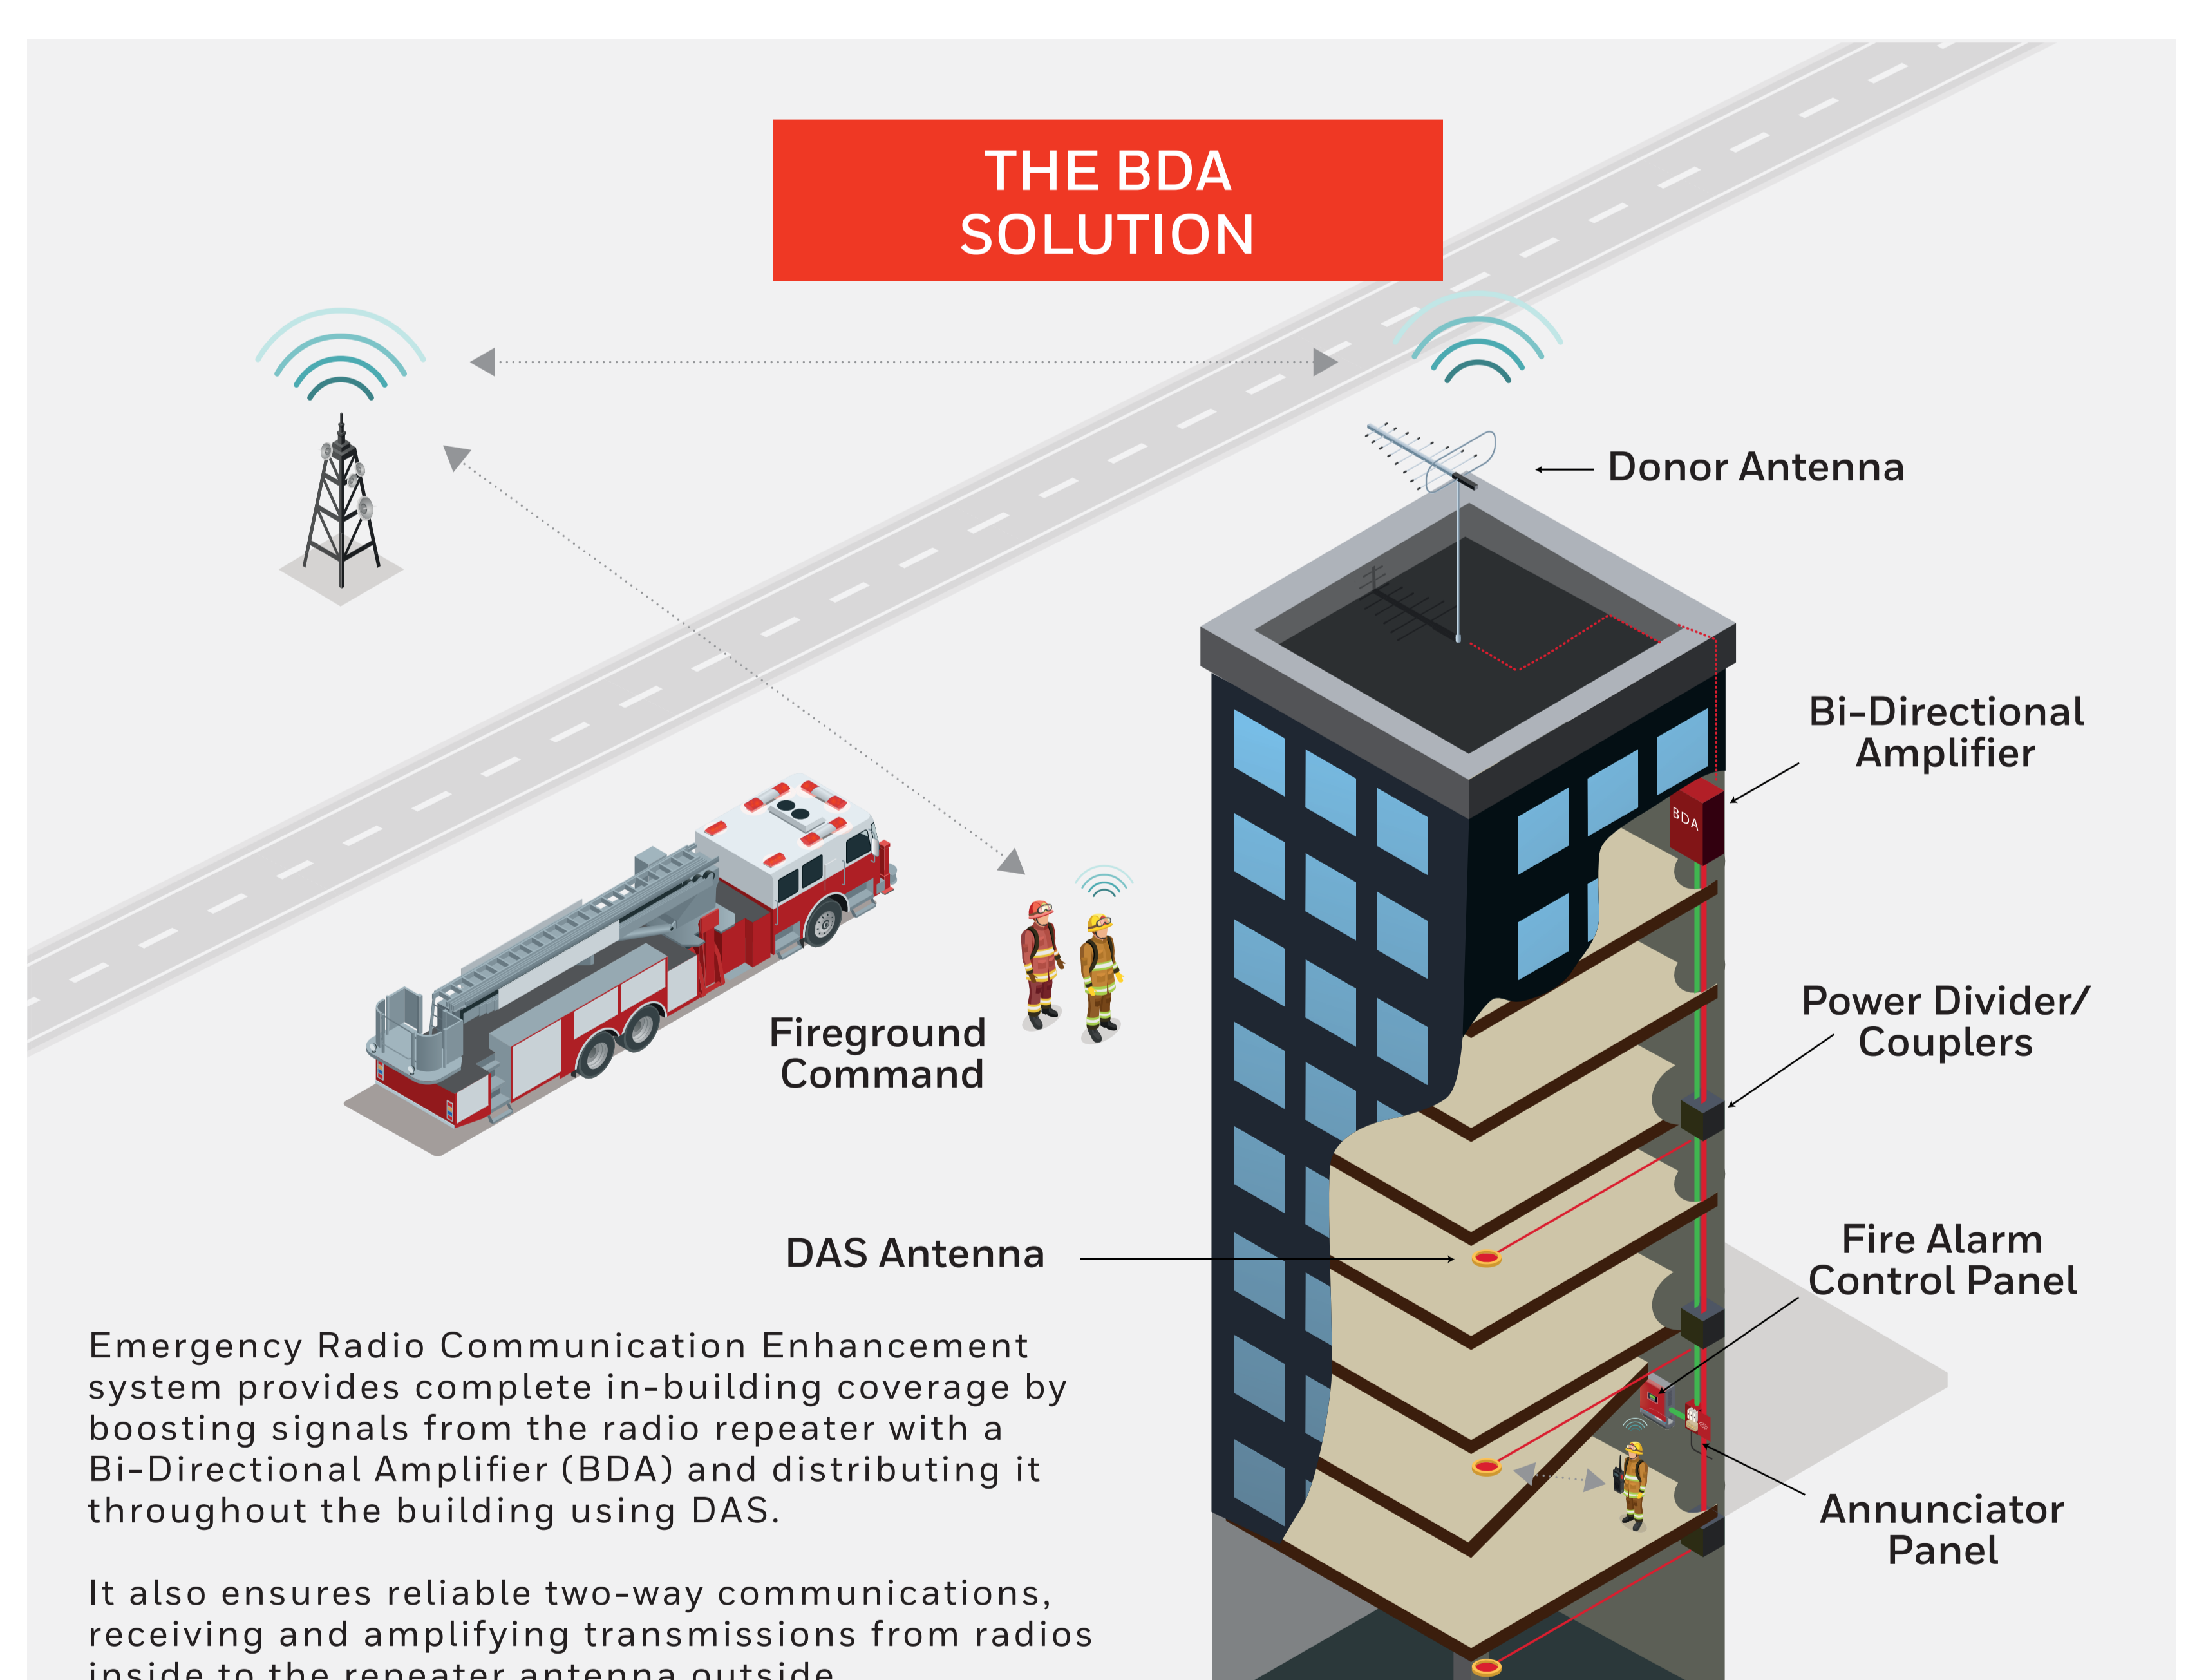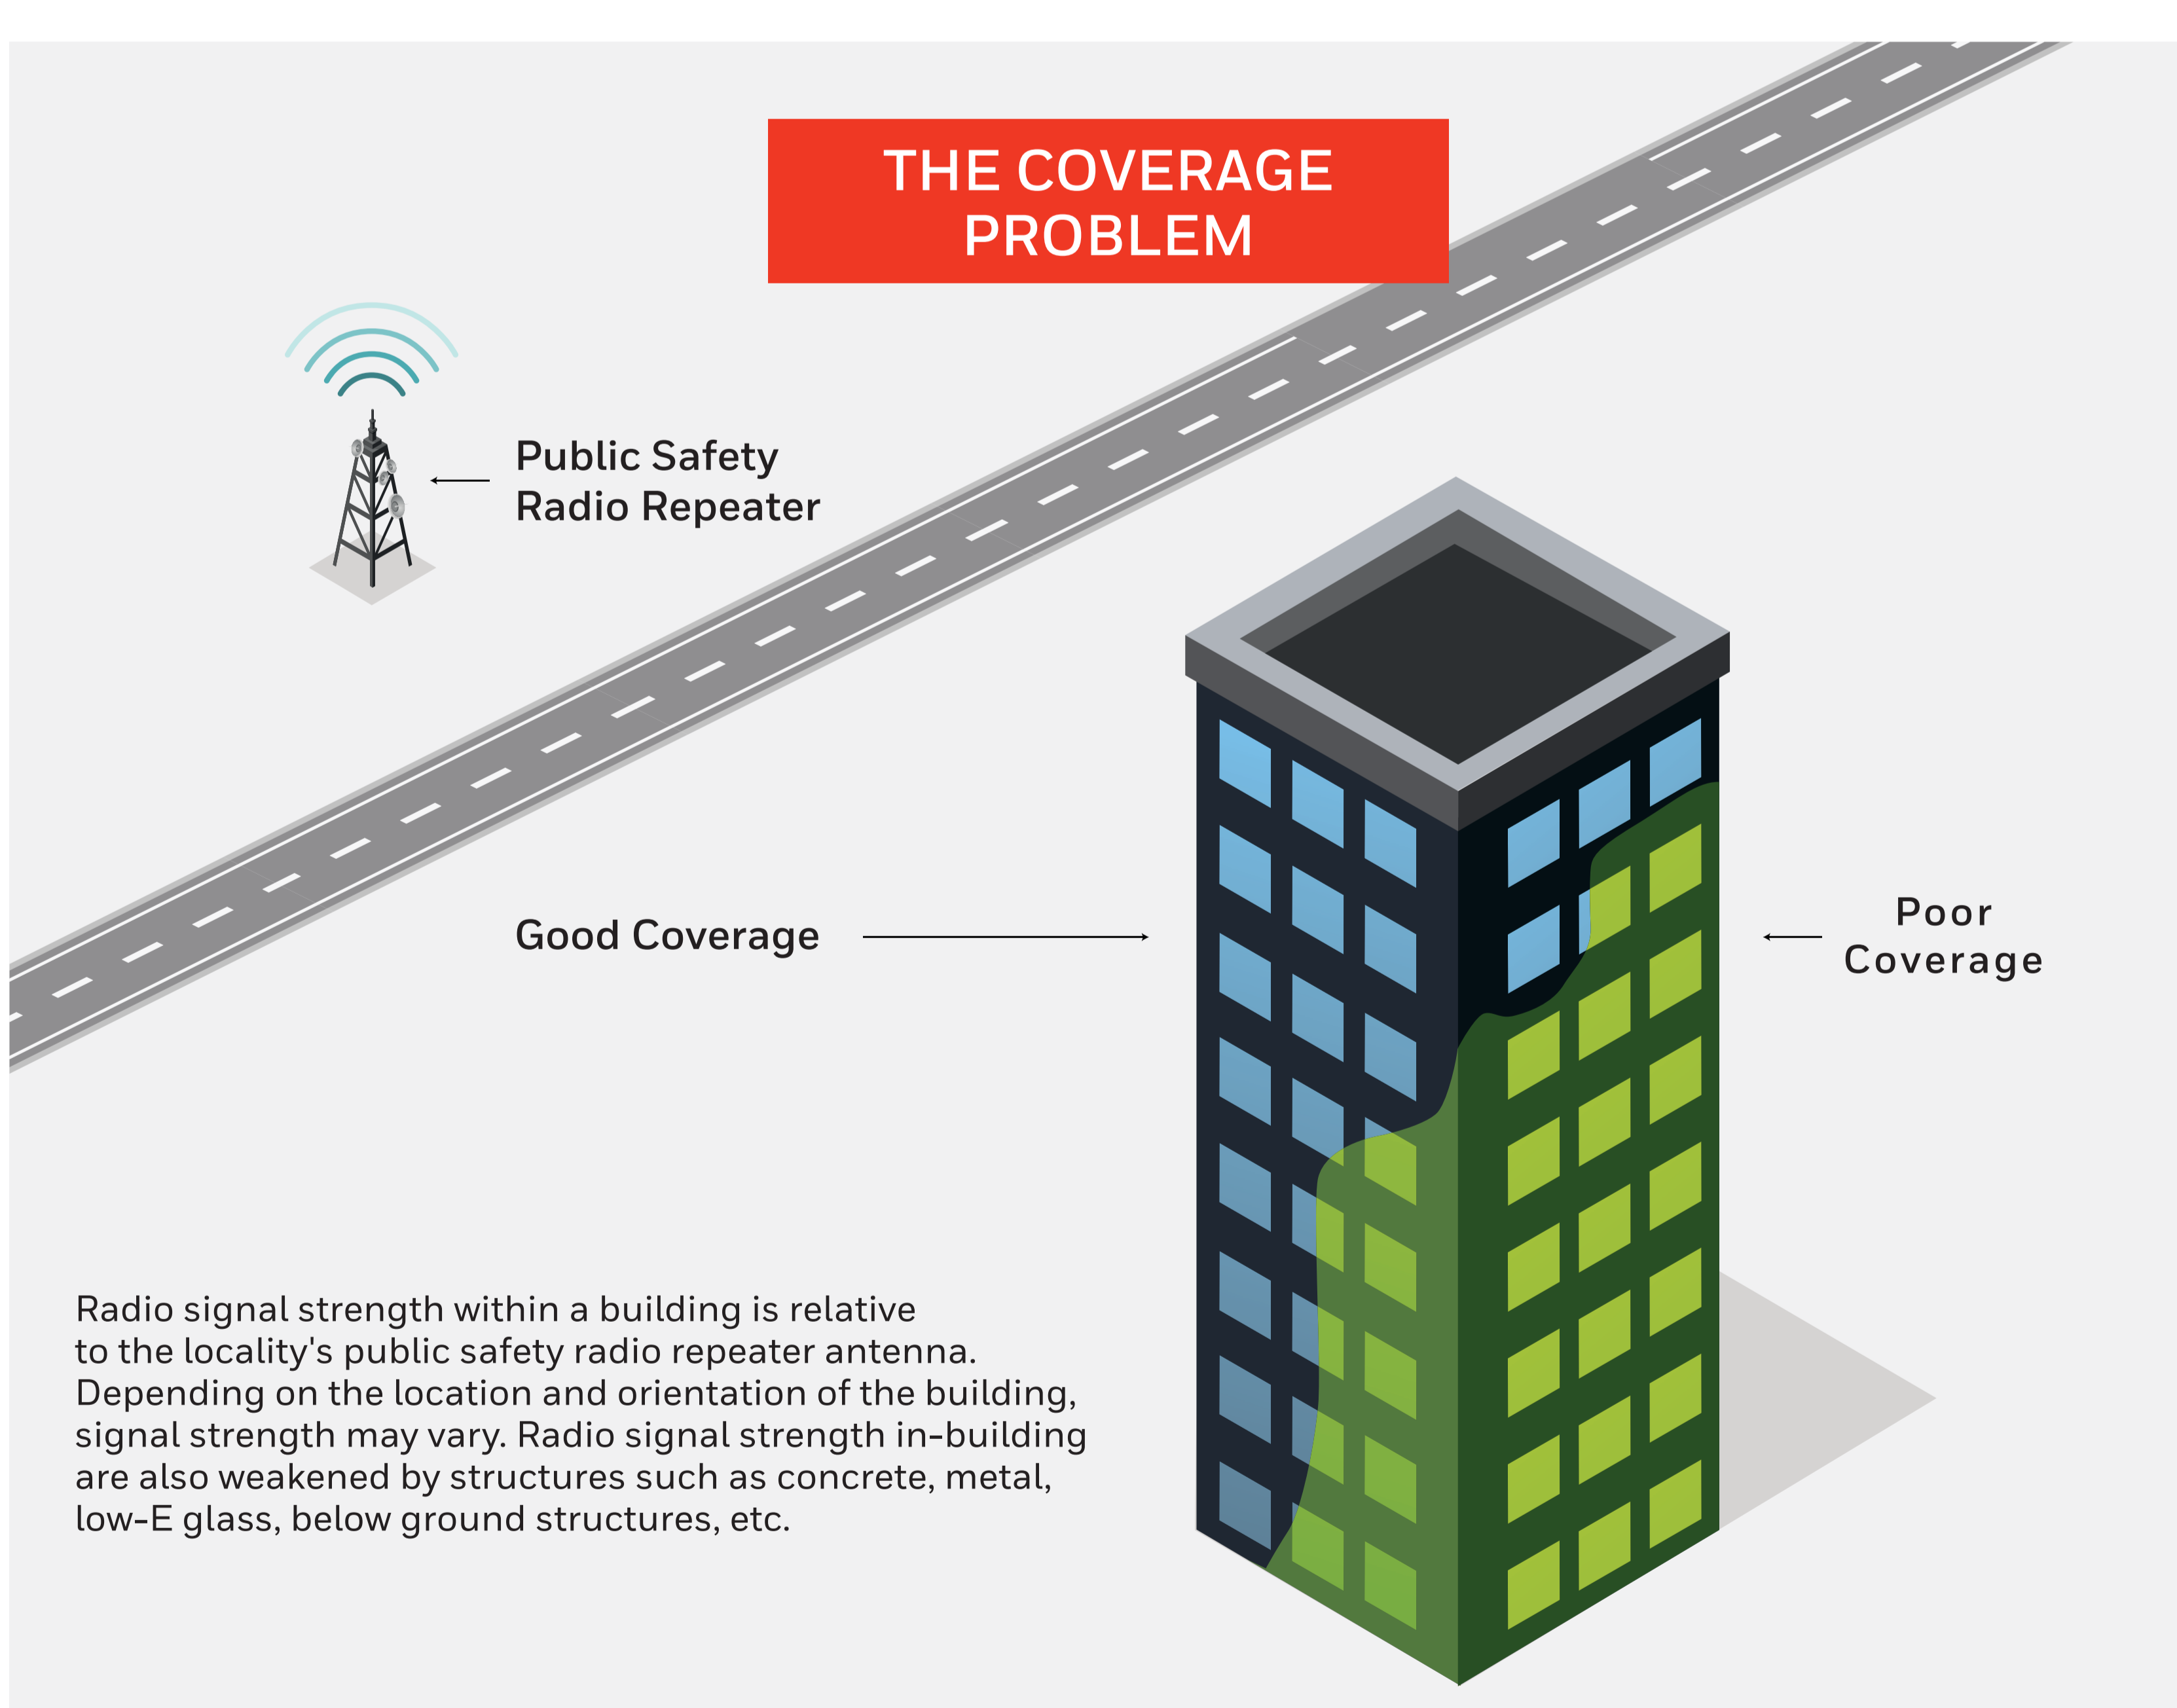

### APPROVED LEVEL OF COVERAGE

Codes require 95%+ emergency responder radio coverage in all new buildings  
IFC 2018 Section 510, NFPA 72 2010, NFPA 1221 2016, IBC 2015 Section 916



### UL PRODUCT LISTING



UL2524 creates a performance standard for all BDA manufacturers, assuring AHJs, A&Es, building owners and occupants that systems work the first time, every time, per IFC and NFPA codes.