


Morley-IAS Lite Panel Firmware Update Guide


Steps to Update the Panel Firmware (Main Version)

The Morley-IAS Lite Fire Alarm Control Panel (Main Version) can be easily updated by following these steps:

1. Download the latest Firmware version from the Morley-IAS Lite technical website: <https://buildings.honeywell.com/gb/en/lp/morleytech>
Please ensure you select the appropriate Firmware for your specific model of the Control Panel.
2. Once the Firmware file is downloaded, extract the files into a folder.
3. **POWER OFF** the mains supply to the Panel. Open the front cover of the Panel and disconnect the Panel's batteries. Ensure the front cover cable is connected firmly, as indicated below.

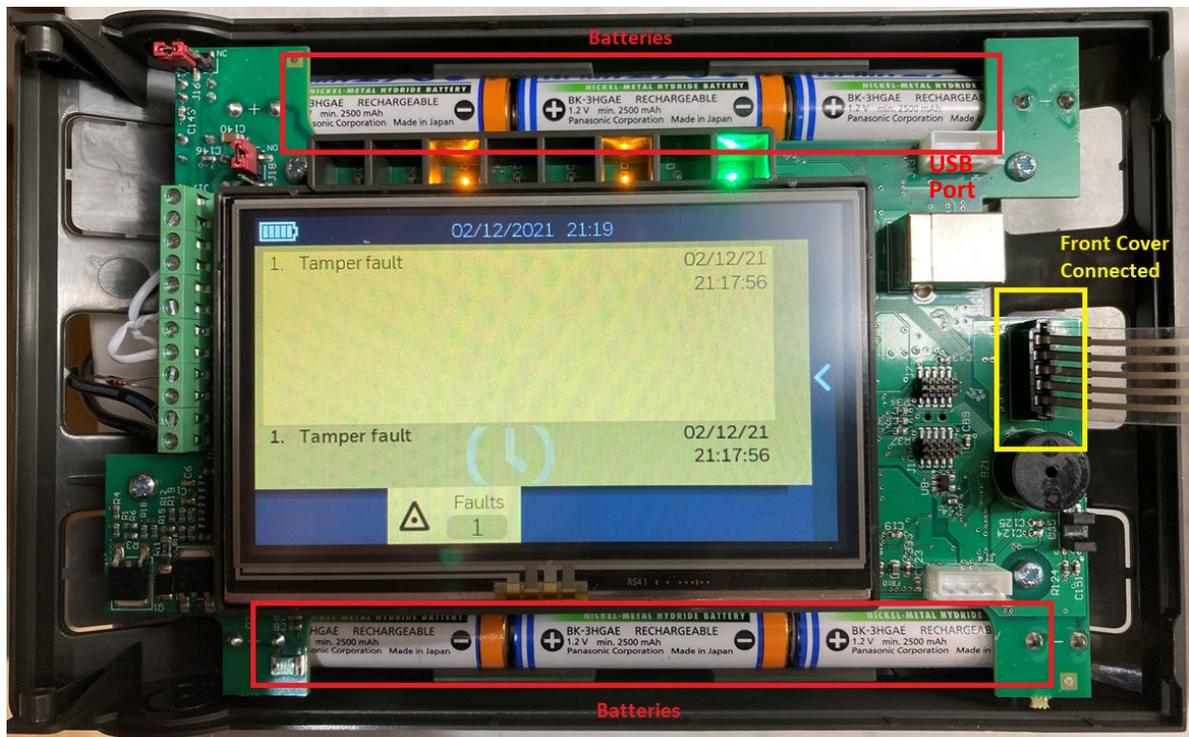


4. Connect a USB cable from a PC to the USB port on the Panel, as indicated above.
5. Press together the **RESET PANEL**  and **MUTE**  buttons on the front cover at the same time, while also **POWERING ON** the mains supply.

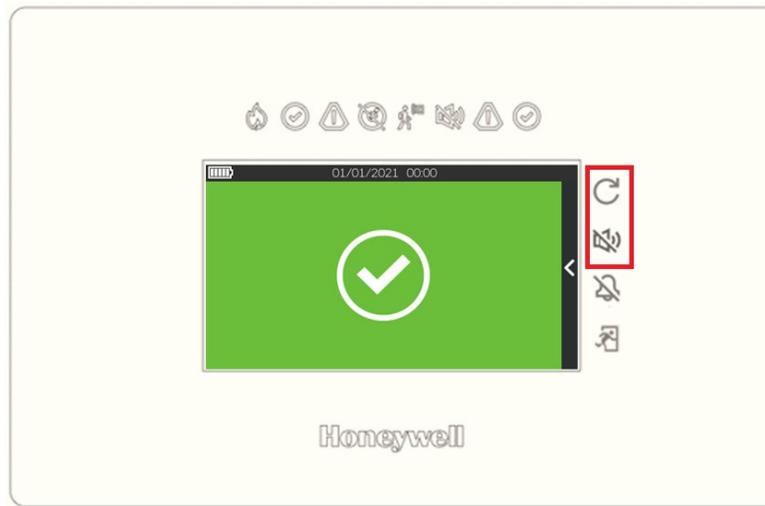


Keep the buttons pressed for approximately 5 seconds, until the Panel enters the **Bootloader Mode**. Once in Bootloader Mode (characterised by a continuous buzzer sound and blank display), release the buttons.

6. Ensure all the below files are present in the extracted folder. Double click on **FlashFirmware_LT159** to start the Firmware update.

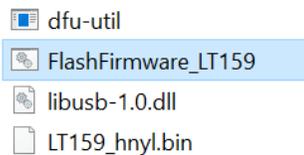

For the LT-32 model, run **FlashFirmware_LT32**



It is crucial not to remove power to the Panel during this process, as it may lead to an incomplete update and potential system issues.

7. The Firmware update will start in a command window, as below. Progress of the Firmware update is indicated at the bottom, as shown.

```
C:\WINDOWS\system32\cmd.exe

C:\Morley_Lite_Firmwares>ECHO OFF
ECHO is off.
No File Provided
dfu utility found
Devnum for 1fc9:00a1 is 11
Flashing Firmware

Waiting for 0 seconds, press a key to continue ...
dfu-util 0.11

Copyright 2005-2009 Weston Schmidt, Harald Welte and OpenMoko Inc.
Copyright 2010-2021 Tormod Volden and Stefan Schmidt
This program is Free Software and has ABSOLUTELY NO WARRANTY
Please report bugs to http://sourceforge.net/p/dfu-util/tickets/

Warning: Invalid DFU suffix signature
A valid DFU suffix will be required in a future dfu-util release
Opening DFU capable USB device...
Device ID 1fc9:00a1
Device DFU version 0101
Claiming USB DFU Interface...
Setting Alternate Interface #0 ...
Determining device status...
DFU state(2) = dfuIDLE, status(0) = No error condition is present
DFU mode device DFU version 0101
Device returned transfer size 512
Copying data from PC to DFU device
Download      [===                               ] 14%      140288 bytes
```

```
C:\WINDOWS\system32\cmd.exe

Flashing Firmware

Waiting for 0 seconds, press a key to continue ...
dfu-util 0.11

Copyright 2005-2009 Weston Schmidt, Harald Welte and OpenMoko Inc.
Copyright 2010-2021 Tormod Volden and Stefan Schmidt
This program is Free Software and has ABSOLUTELY NO WARRANTY
Please report bugs to http://sourceforge.net/p/dfu-util/tickets/

Warning: Invalid DFU suffix signature
A valid DFU suffix will be required in a future dfu-util release
Opening DFU capable USB device...
Device ID 1fc9:00a1
Device DFU version 0101
Claiming USB DFU Interface...
Setting Alternate Interface #0 ...
Determining device status...
DFU state(2) = dfuIDLE, status(0) = No error condition is present
DFU mode device DFU version 0101
Device returned transfer size 512
Copying data from PC to DFU device
Download      [=====] 100%      956852 bytes
Download done.
DFU state(6) = dfuMANIFEST-SYNC, status(0) = No error condition is present
DFU state(8) = dfuMANIFEST-WAIT-RESET, status(0) = No error condition is present
Resetting USB to switch back to runtime mode
Done!

Waiting for 12 seconds, press a key to continue ...
```

8. Once the download is complete, successful update messages will appear (as shown above) and the Panel will automatically boot up with the Morley-IAS logo screen.

9. The Panel is now operational. Go to the **Panel configuration** menu and verify the **Main Version**.

10. Go to the **Date/Time** menu and set the correct **Date** and **Time**.

Congratulations! You have successfully updated the Firmware on your Morley-IAS Lite Fire Alarm Control Panel. Make sure to regularly check for Firmware updates to ensure the optimum performance and functionality of your fire alarm system.